




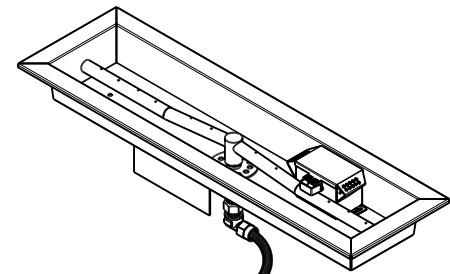



**Hearth Products Controls Co**  
**CSA CERTIFIED-OUTDOOR USE ONLY**  
**FOR COMMERCIAL AND RESIDENTIAL USE**

HEARTH PRODUCTS CONTROLS  
3050 PLAINFIELD RD.  
KETTERING, OH 45432  
TOLL FREE: 1-877-433-7001  
PHONE: (937) 433-7000  
FAX: (937) 433-0704  
[www.hpcfire.com](http://www.hpcfire.com)

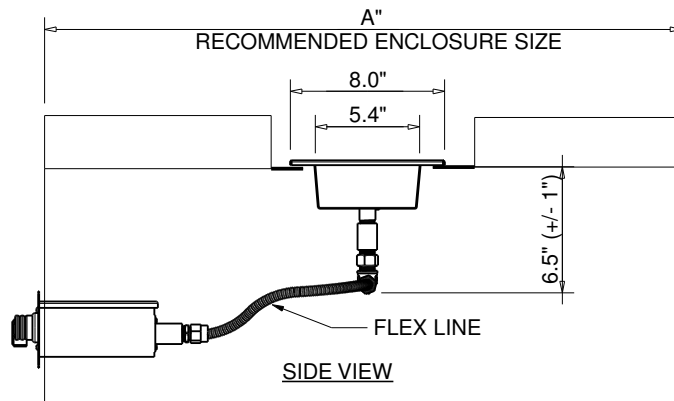

ISOMETRIC VIEW

VALVE BOX DETAIL

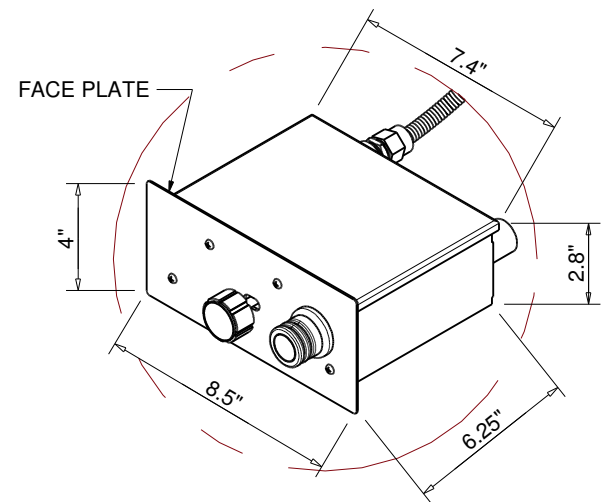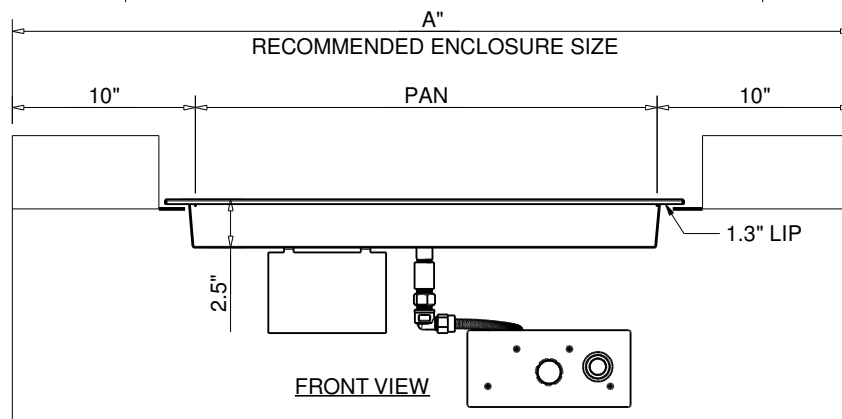


VALVE BOX DETAIL

SPARK IGNITION BY AA BATTERY  
MATERIAL: 304 STAINLESS STEEL

PART NUMBERS	PAN	BURNER		A"	STND FLEX LINE LENGTH
		SIZE	BTU		
FPPK24-TRGH-FLEX	24.5"	23.5"	50K	44LX24W	36"
FPPK36-TRGH-FLEX	36.5"	35.5"	75K	56LX24W	36"
FPPK48-TRGH-FLEX	48.5"	47.5"	90K	68LX24W	36"
FPPK60-TRGH-FLEX	60.5"	59.5"	90K	80LX24W	36"
FPPK72-TRGH-FLEX	72.5"	71.5"	140K	92LX24W	36"
FPPK96-TRGH-FLEX	96.5"	95.5"	140K	116LX24W	36"

Notes:

1. PROPER VENTING
    - ENCLOSURES: Recommend 4 each 18 sq.in. vents on opposing sides (Minimum 2 each 18 sq.in. vents).
  2. GAS SUPPLY - FOR USE WITH FIXED PIPING SYSTEMS OR FOR USE WITH SMALL TANKS UP TO 90K.
    - Natural Gas: Operating Supply Pressure: Minimum: 6.0" W.C.; Maximum: 7.0" W.C.
    - LP Gas: Operating Supply Pressure: Minimum: 10.0" W.C.; Maximum: 11.0" W.C.
- IMPORTANT: Ensure any flex line that may be used from the permanent main fuel supply to the product is rated to the stated max btu of the product and certified to ANSI Z21.75\*CSA 6.27.
5. MODIFICATION OF PRODUCT WILL VOID ANY CERTIFICATION AND WARRANTY.
  6. FOLLOW ALL MANUFACTURER INSTALLATION INSTRUCTIONS AND LOCAL CODES.
  7. ALL DIMENSIONS ARE CONSIDERED TRUE AND REFLECT MANUFACTURER'S SPECIFICATIONS AS OF THE REVISION DATE.
  8. DO NOT SCALE DRAWING.
  9. THESE DRAWINGS ARE FOR SIZING AND PLANNING PURPOSES. ALL INFORMATION CONTAINED HEREIN WAS CURRENT AT THE TIME OF DEVELOPMENT. THE MANUFACTURER'S RESPONSIBLE FOR THE ACCURACY OF THE DRAWING.
  10. CONTRACTOR'S NOTE: FOR PRODUCT AND COMPANY INFORMATION VISIT [www.CADdetails.com/info](http://www.CADdetails.com/info)
- REFERENCE NUMBER 771-005.



PUSH BUTTON/FLAME SENSING FIRE PIT INSERT - WITH FLEX LINE  
LINEAR TROUGH PAN - FPPK